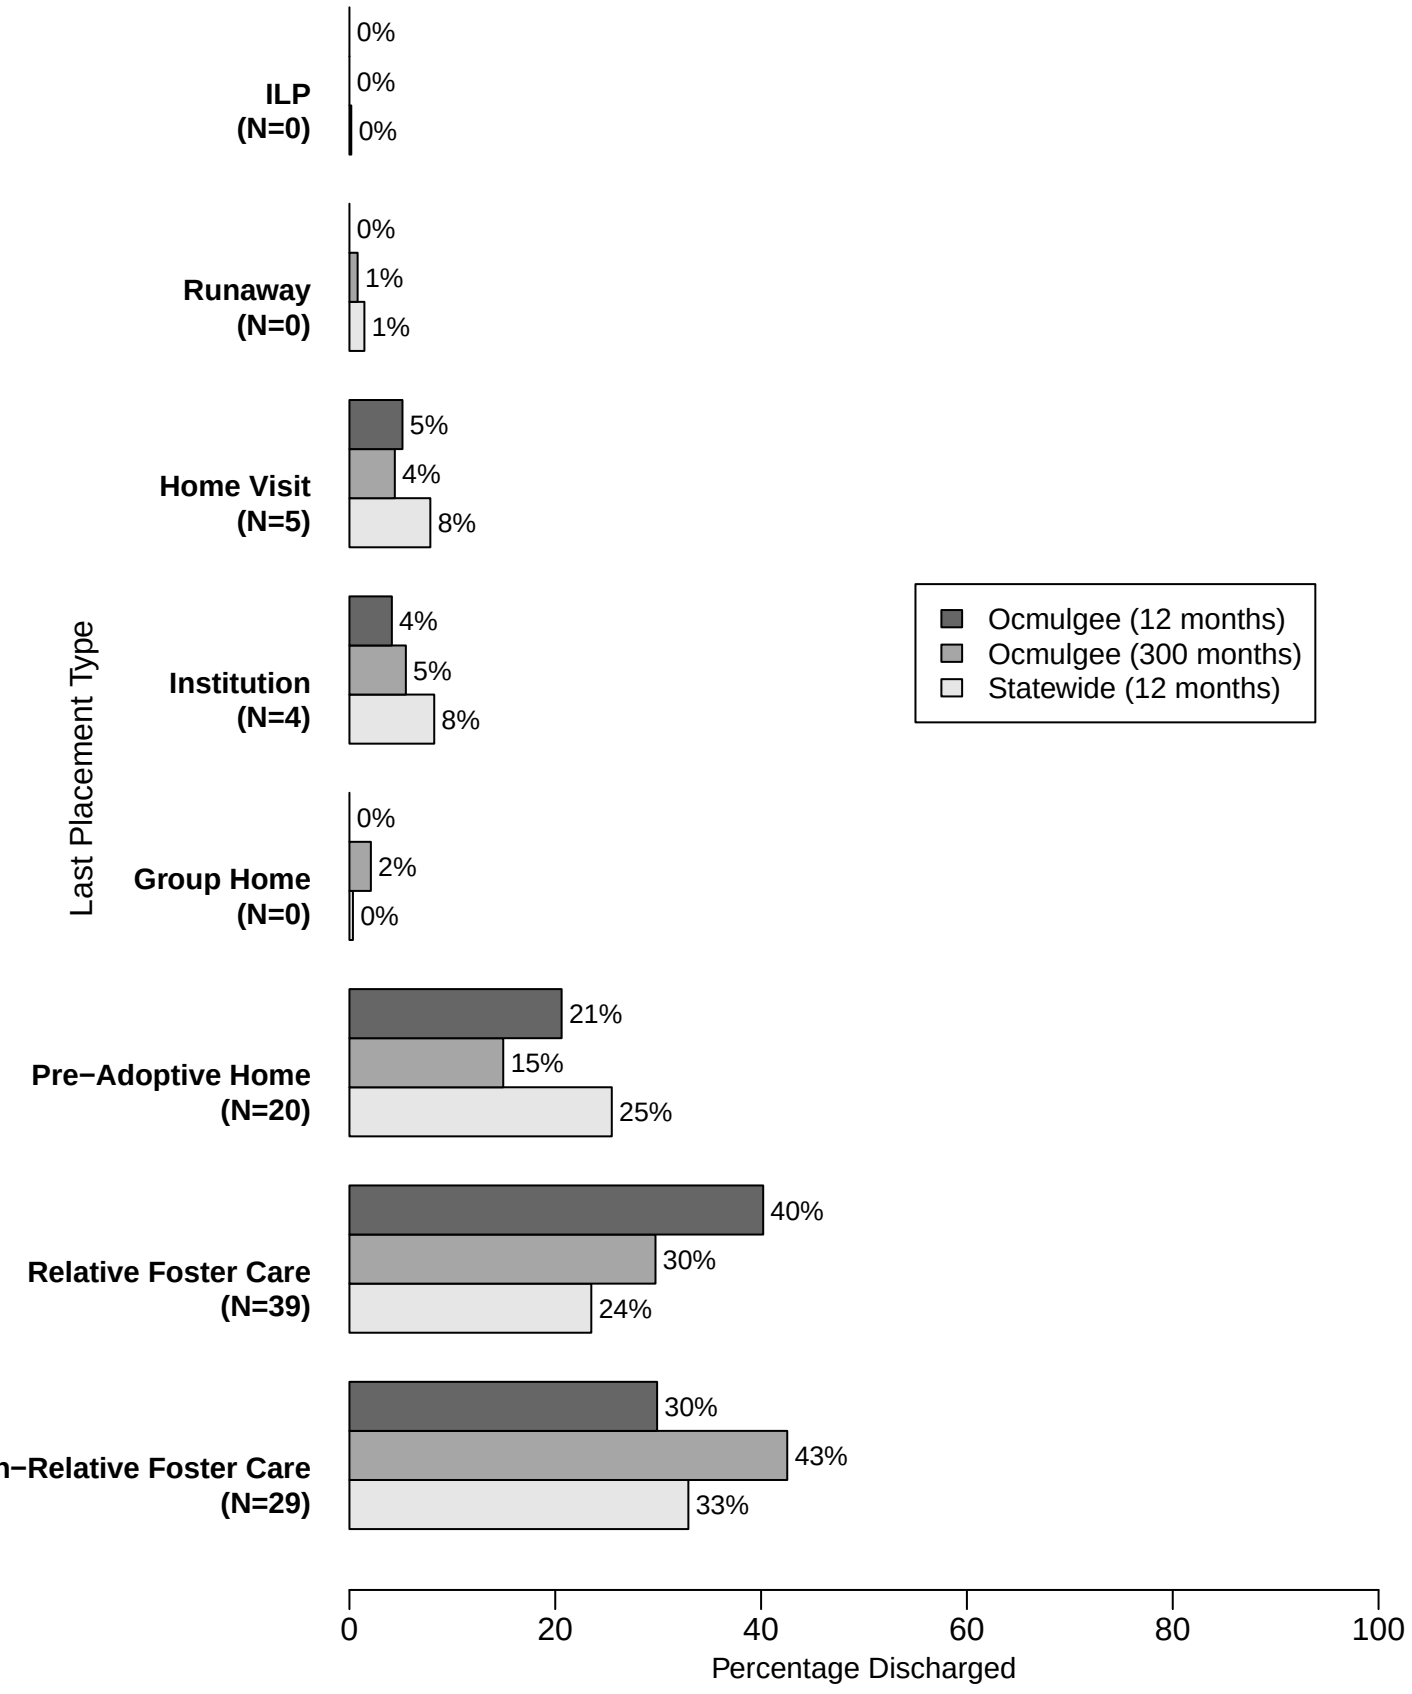Ocmulgee Circuit: Percentage Discharged by Last Placement Type